


A Stanchion Detail E-501 SCALE: NTS

NOTES:


- AREAS.

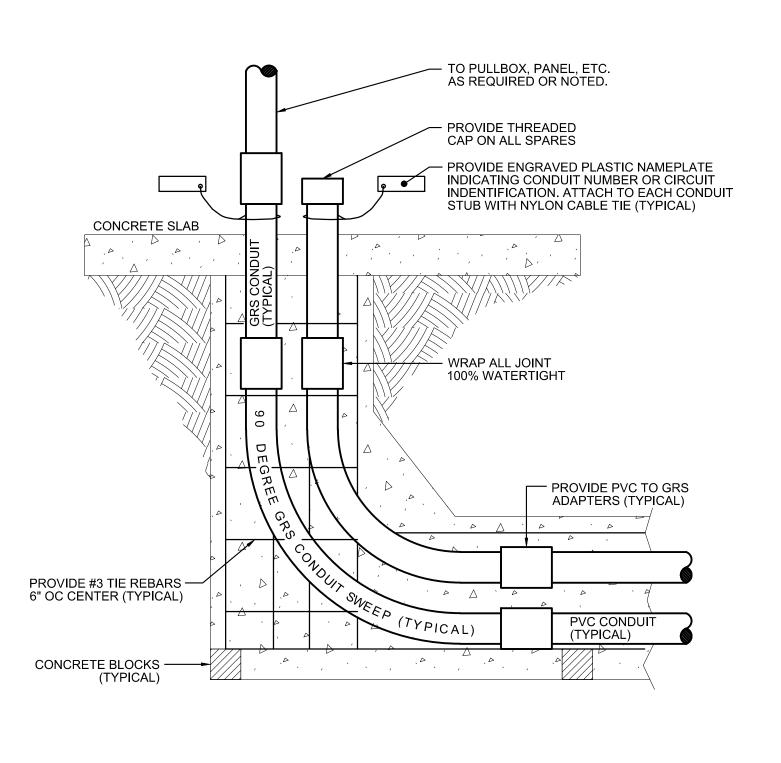

Conduit Stub-Up Detail E-501 SCALE: NTS

NOTES:


A. REFER TO PAVEMENT RESTORATION DETAILS FOR ADDITIONAL WORK REQUIRED.

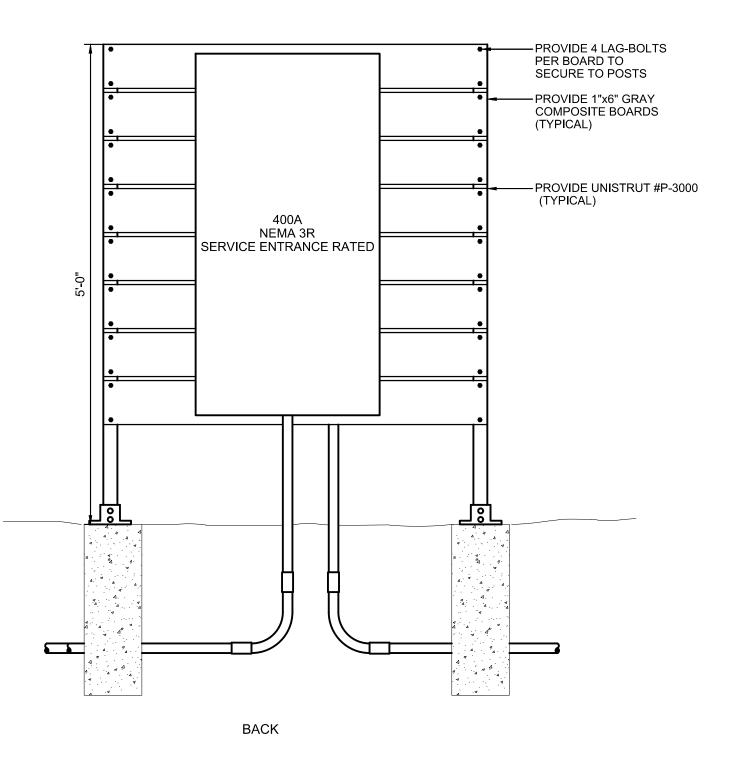

A. ALL OPENINGS FOR CONDUITS SHALL BE MADE IN FIELD ACCORDING TO CONDUIT SIZES AND QUANTITIES.


B. SUITABLE FOR DIRECT BURIAL IN CONCRETE AND GRASS


C. COVER SHALL SUPPORT 12,000 LBS, TIER 8 RATING, MINIMUM. D. PROVIDE STACKABLE SECTIONS AS REQUIRED FOR A 26" DEPTH. E. RESISTANT TO SUNLIGHT, WEATHERING, AND FREEZING. F. DESIGN MAKE QUAZITE PG STACKABLE SERIES.

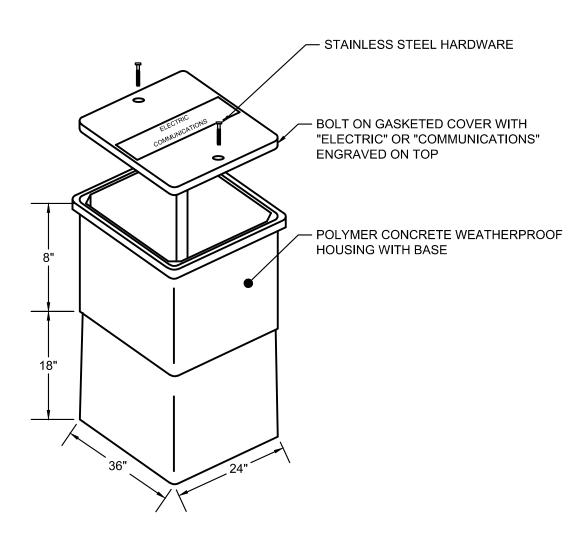



(TELECOMMUNICATIONS) LINE BELOW." TAPE SHALL BE LOCATED 6" BELOW FINISHED GRADE.

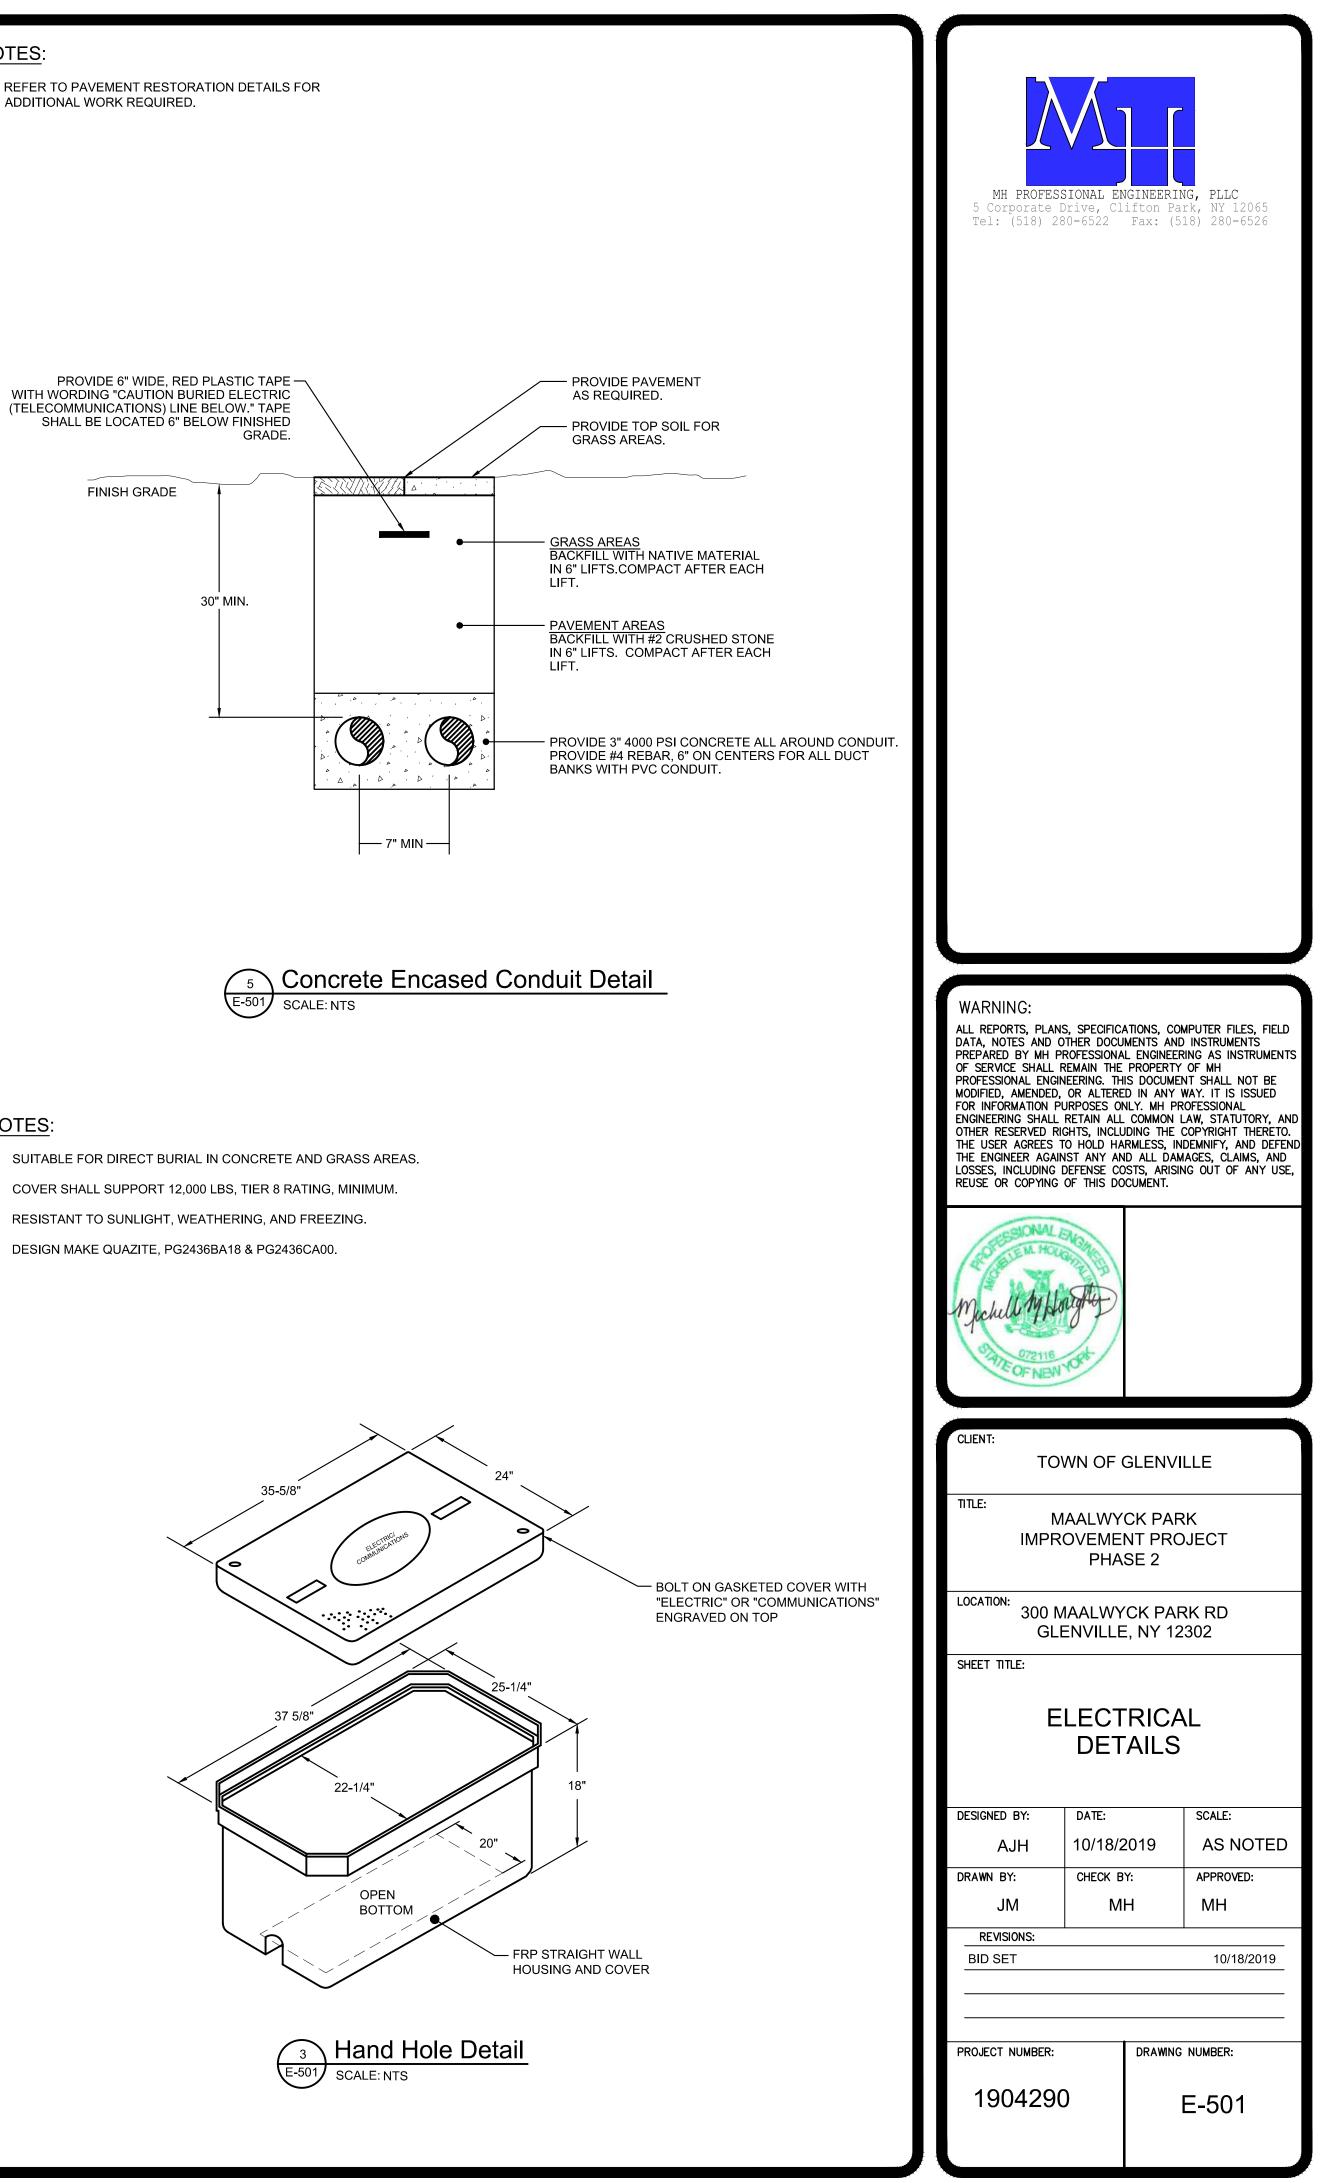

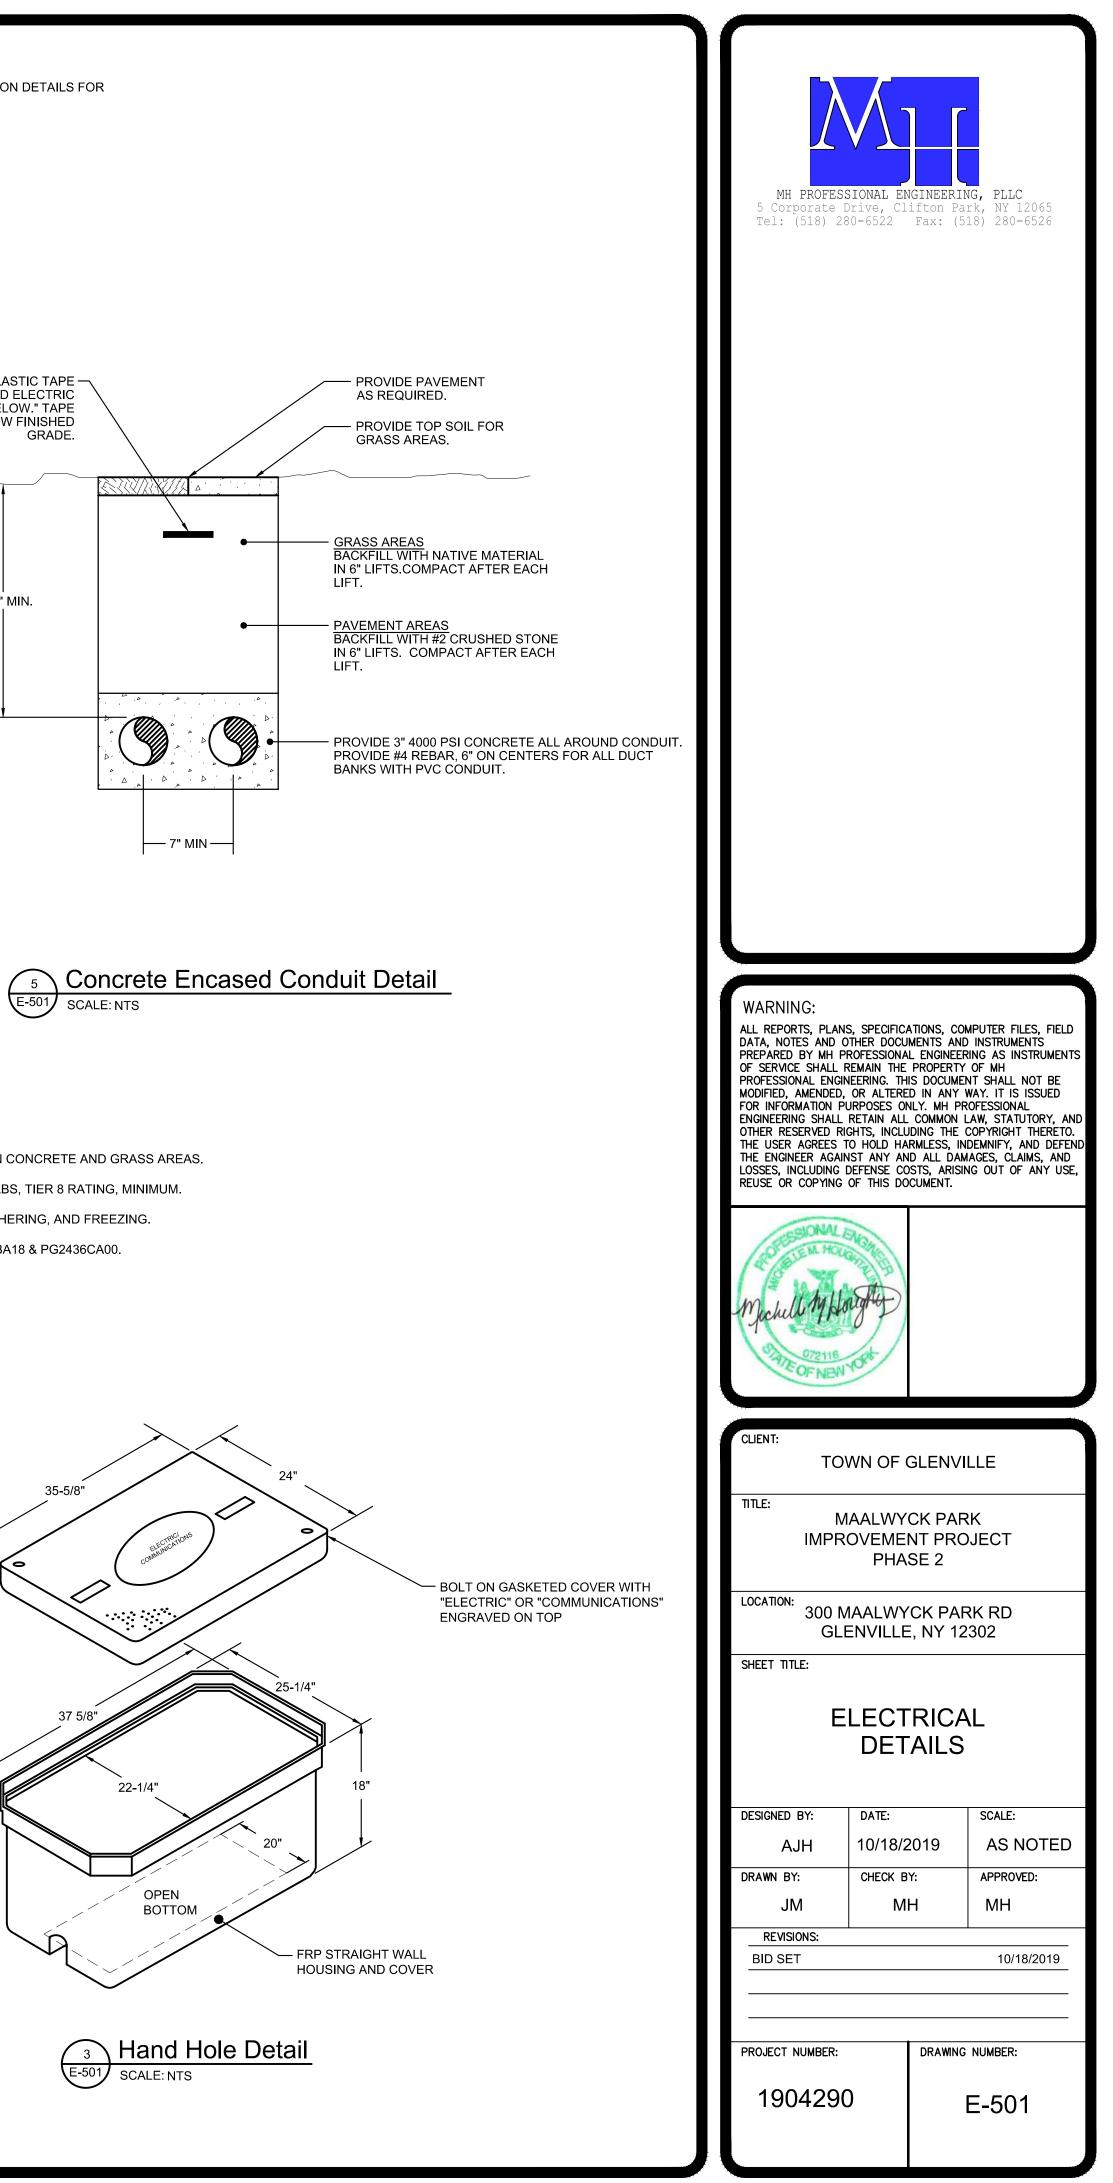

NOTES:

- A. SUITABLE FOR DIRECT BURIAL IN CONCRETE AND GRASS AREAS.
- B. COVER SHALL SUPPORT 12,000 LBS, TIER 8 RATING, MINIMUM.
- C. RESISTANT TO SUNLIGHT, WEATHERING, AND FREEZING.
- D. DESIGN MAKE QUAZITE, PG2436BA18 & PG2436CA00.

